

Statistical Information:

Fire Dollar Loss

| Total Fire Loss | | |
|-----------------|----------------------|-----------------|
| | Total Investigations | Total Fire Loss |
| 2010 | 202 | \$27,579,878.00 |


| Total Fire Loss - Arson | | |
|-------------------------|----------------------|-----------------|
| | Total Investigations | Total Fire Loss |
| 2010 | 49 | \$5,394,159.00 |

| Total Fire Loss - Accidental | | |
|------------------------------|----------------------|-----------------|
| | Total Investigations | Total Fire Loss |
| 2010 | 124 | \$17,938,719.00 |

| Total Fire Loss - Undetermined | | |
|--------------------------------|----------------------|-----------------|
| | Total Investigations | Total Fire Loss |
| 2010 | 29 | \$4,247,000.00 |

Investigations by Agency

Fires Investigated by SCFMO
2010

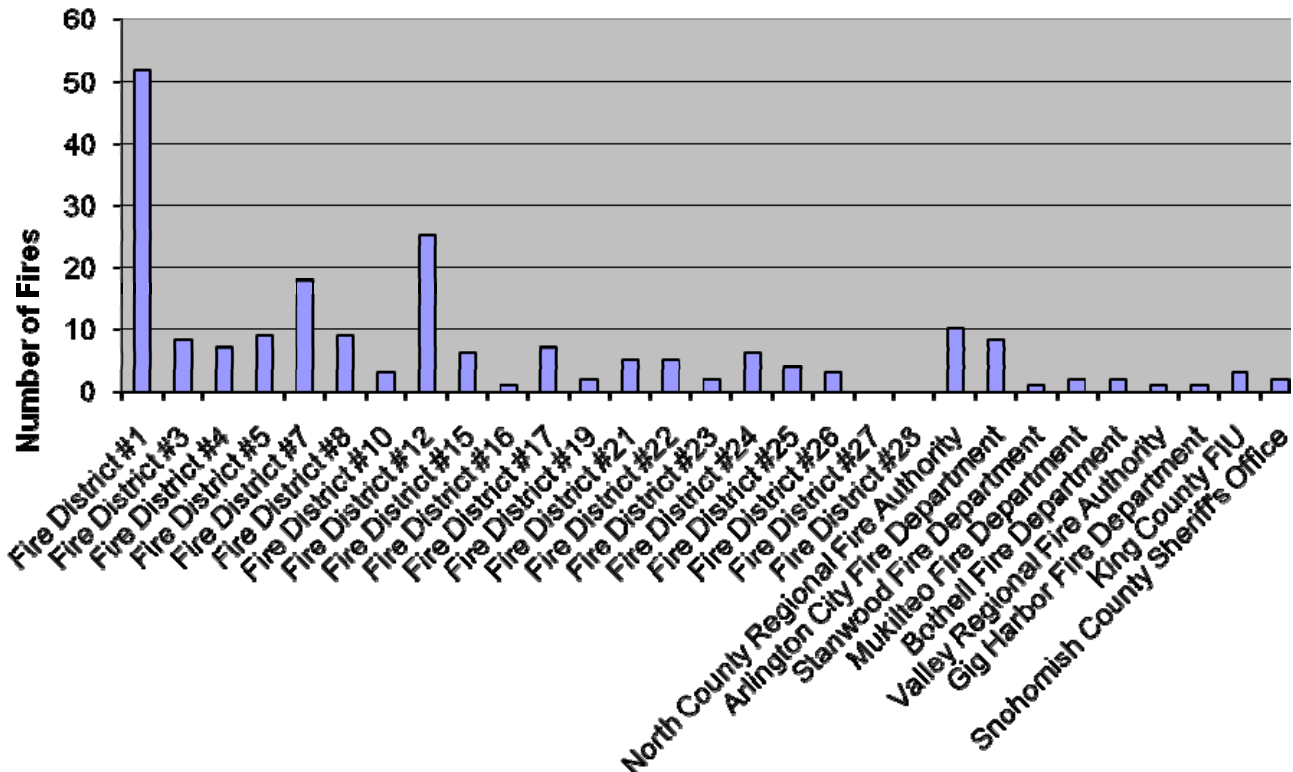

Fire Inspections

| | | |
|------|-------------------|----------------------|
| 2010 | Total Inspections | Total Re-Inspections |
| | 2,095 | 618 |

Number of Violations

| | |
|------|------------------|
| 2010 | Total Violations |
| | 3,378 |

Top Five Violations and Definitions

| Violation | Definition |
|-------------------------------------|---|
| Fire Extinguishers – Annual Service | Have the fire extinguisher(s) serviced and tagged by a certified technician (901.6 & NFPA 10). |
| Extension Cords | Remove extension cords unless they are used only for temporary, portable or seasonal equipment (portable heaters excluded) and they shall not be run through walls, under doors or be subject to damage. Extension cords shall not be used as a substitute for permanent wiring (605.5) |
| Access to Electrical Panels | Maintain clear access to electrical panel, at least 30 inches wide and 36 inches in front, and 78 inches in height (605.3) |
| Exits Signs | Exit signs shall be externally or internally illuminated or e self luminous. Provide working bulbs and emergency backup power (1011.2 & 1011.5.3) |
| Electrical Outlets | Place approved covers on electrical outlets, switches and exposed wires (605.6) |

Total Plan Reviews

| | | |
|------------------------|----------------------|-------------|
| Structural Plan Review | Land Use Plan Review | Site Visits |
| 171 | 176 | 53 |

Acceptance testing

| | | |
|------------|------------------|-------------|
| Fire Alarm | Sprinkler System | Hood & Duct |
| 44 | 97 | 4 |

Special Event Inspections

| | |
|----------------|-------------------|
| SE Inspections | SE Re-Inspections |
| 339 | 91 |